




La solution assistance

# CT6520NFIL


# SABA

## Tableau de valeur des sondes

Tx(°C)	R (KΩ)								
-30	33.81	-15	14.31	0	6.495	15	3.141	30	1.617
-29	31.85	-14	13.55	1	6.175	16	2.999	31	1.55
-28	30.01	-13	12.83	2	5.873	17	2.865	32	1.486
-27	28.29	-12	12.16	3	5.587	18	2.737	33	1.426
-26	26.68	-11	11.52	4	5.315	19	2.616	34	1.368
-25	25.17	-10	10.92	5	5.06	20	2.501	35	1.312
-24	23.76	-9	10.35	6	4.818	21	2.391	36	1.259
-23	22.43	-8	9.82	7	4.589	22	2.287	37	1.209
-22	21.18	-7	9.316	8	4.372	23	2.188	38	1.161
-21	20.01	-6	8.841	9	4.167	24	2.094	39	1.115
-20	18.9	-5	8.392	10	3.972	25	2.005	40	1.071
-19	17.87	-4	7.968	11	3.788	26	1.919	41	1.029
-18	16.9	-3	7.568	12	3.613	27	1.838	42	0.9885
-17	15.98	-2	7.19	13	3.447	28	1.761	43	0.9506
-16	15.12	-1	6.833	14	3.29	29	1.687	44	0.914

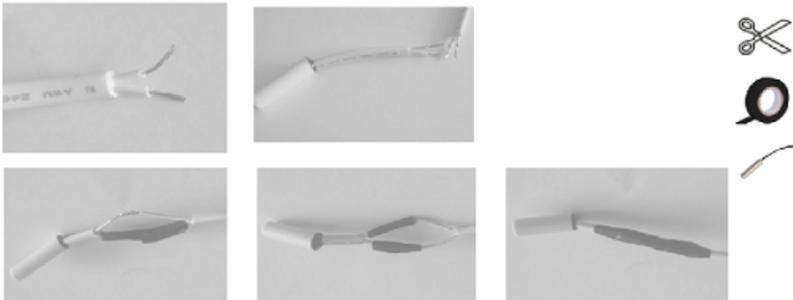

Sonde FMF112010070795

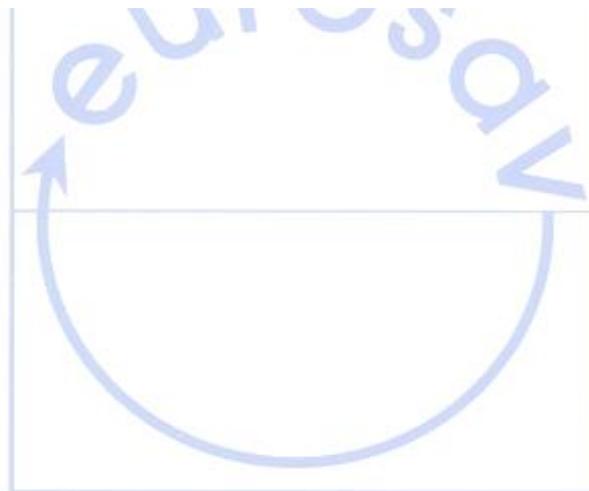

*La solution assistance*